

MR12 plug-in modules

Terminal plan:

Outputs 230VAC


1P1 Pump of Heating Circuit 1 1
 1M1 Circuit 1 of Mixed Valve OPEN 2
 1M1 Circuit 1 of Mixed Valve CLOSED 3

Outputs 230VAC

2P1 Pump of Heating Circuit 2 1
 2M1 Circuit 2 of Mixed Valve OPEN 2
 2M1 Circuit 2 of Mixed Valve CLOSED 3

Outputs 230VAC

3P1 Pump of Heating Circuit 3 1
 3M1 Circuit 3 of Mixed Valve OPEN 2
 3M1 Circuit 3 of Mixed Valve CLOSED 3

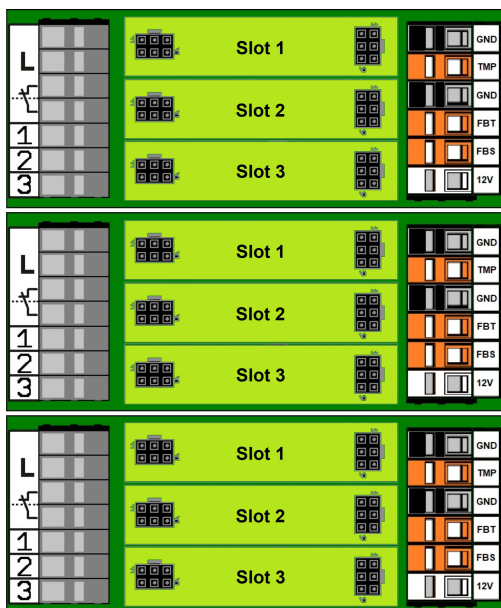

Heating Module Circuit 1


GND
 TMP 1T1 Flow Temperature Circuit 1
 GND Remote Control Circuit 1
 FBT Remote Control Room Temperature
 FBS Remote Control Signal
 12V VCC 12VDC

Heating Module Circuit 2

GND
 TMP 2T1 Flow Temperature Circuit 2
 GND Remote Control Circuit 2
 FBT Remote Control Room Temperature
 FBS Remote Control Signal
 12V VCC 12VDC


Heating Module Circuit 3

GND
 TMP 3T1 Flow Temperature Circuit 3
 GND Remote Control Circuit 3
 FBT Remote Control Room Temperature
 FBS Remote Control Signal
 12V VCC 12VDC

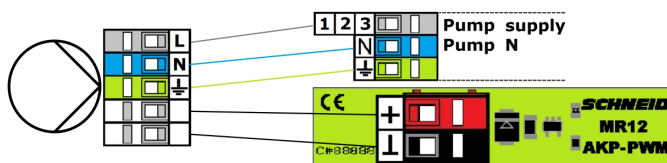


(Excerpt from the AKP-connection sheet)

Slot 1-3
 (depending on the configuration required)

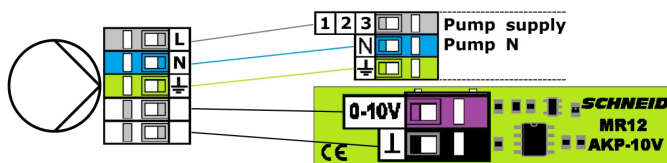


(Excerpt from the AKP-connection sheet)

Slot 1-3
 (depending on the configuration required)

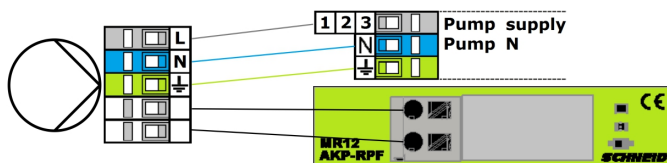

(Excerpt from the AKP-connection sheet)

Slot 1-3
 (depending on the configuration required)

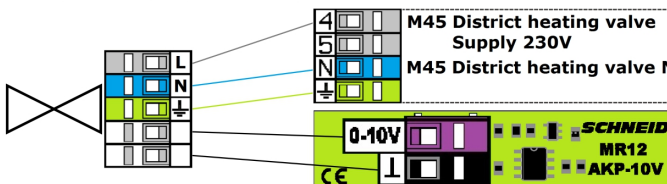

(Excerpt from the AKP-connection sheet)

Slot 4

